

4

3

2

1

C


C

B


B

A

A

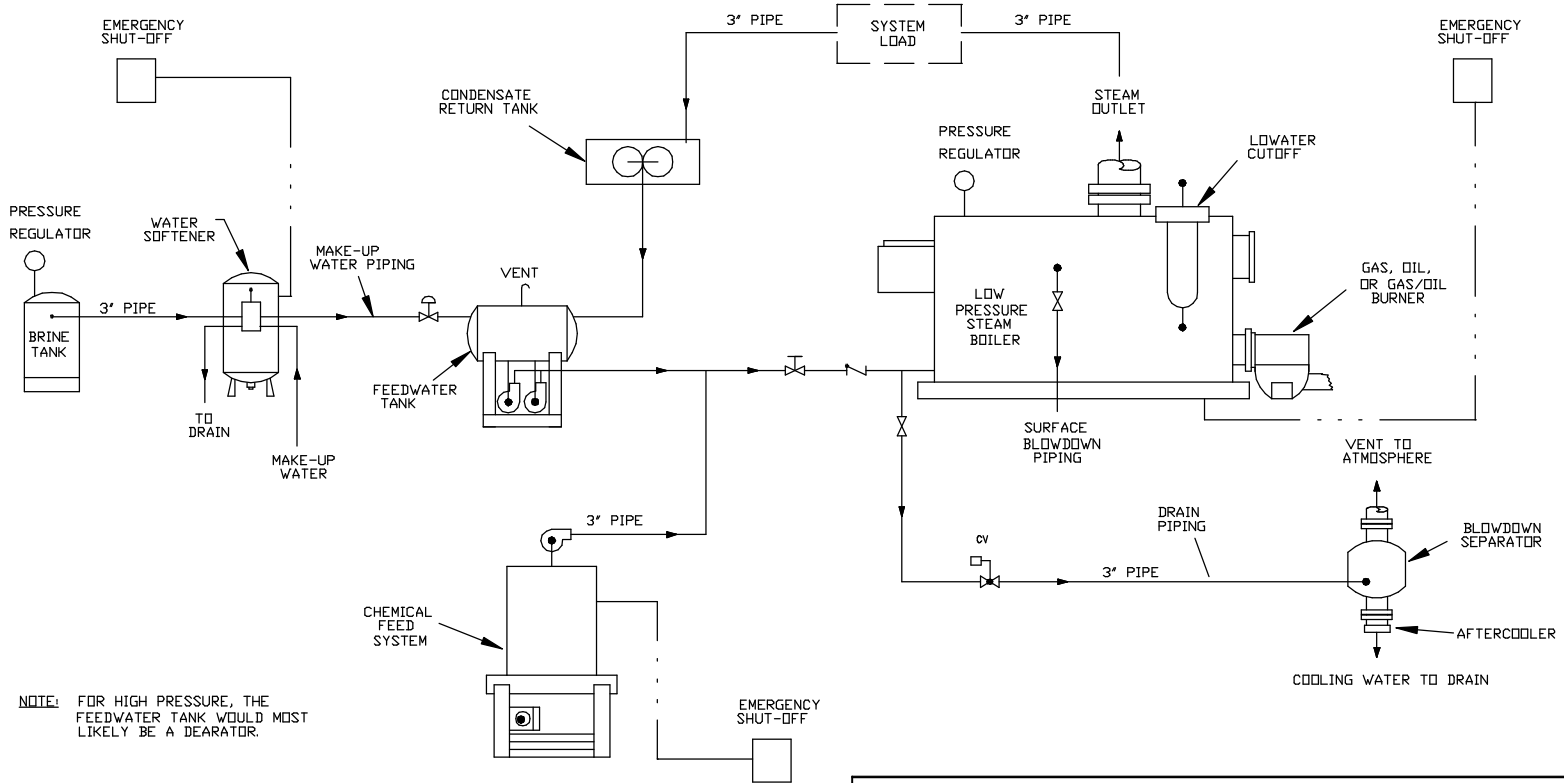

NOTE: FOR HIGH PRESSURE, THE FEEDWATER TANK WOULD MOST LIKELY BE A DEARATOR.

CUSTOMER:			
PLANT:			
CONTRACTING FIRM:		TYPICAL BOILER ROOM SCHEMATIC	
 <b>INTEGRAL CONTROL SYSTEM SERVICES, INC.</b> 3568 State Road #4 Cuyahoga Falls, Ohio 44223 Office: 330-923-6900 Fax: 330-923-2116		ICSS JOB NO.:	
		CUST. ORDER NO.:	
DATE:		SCALE: NONE	
<small>THIS DRAWING IS THE PROPERTY OF INTEGRAL CONTROL SYSTEM SERVICES, INC. NEITHER THE DRAWING, NOR REPRODUCTIONS OF IT, NOR INFORMATION DERIVED FROM IT IS TO BE GIVEN TO OTHERS. NO USE IS TO BE MADE OF IT WHICH IS OR MAY BE INJURIOUS TO INTEGRAL CONTROL SYSTEM SERVICES, INC.</small>		REV	DWN LA
			ENGR
AutoCAD File: BOILERRMSCHEMATIC.DWG		B 082900-2	
	APVD	MM	

REV	DATE	CHANGE	ENGR	APVD	REV	DATE	CHANGE	ENGR	APVD

4

3

2

1